



T&S BRASS AND BRONZE WORKS, INC.

2 SADDLEBACK COVE / P.O. BOX 1088 / TRAVELERS REST, SC 29690

PHONE 800-476-4103

FAX 864- 834-3518



REG.#A2601
ISO #9002

Model No.


BL-5550-09

Item No.:

Job Name:

Architect/Engineer Approval:

Notes:

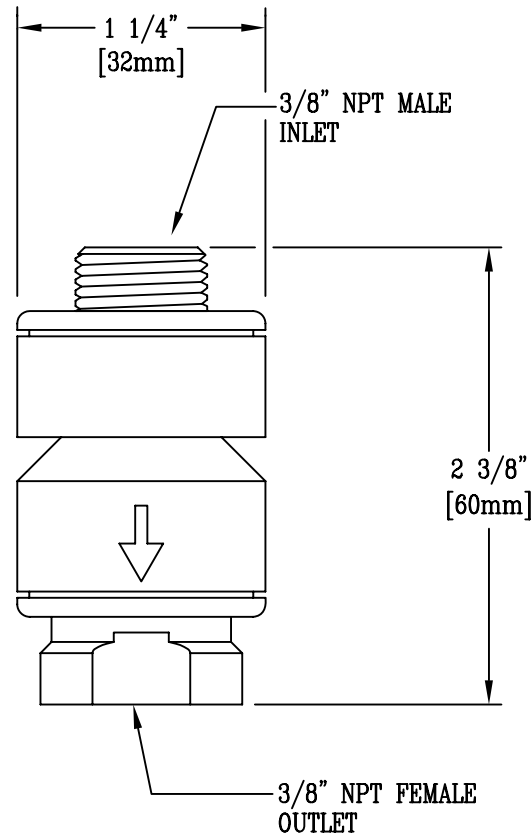

NOTE: THIS PRODUCT IS NOT DESIGNED &/OR RATED
FOR POTABLE / DRINKING WATER APPLICATIONS

NOTE: THIS PRODUCT IS NOT DESIGNED &/OR RATED
FOR CONTINUOUS PRESSURE APPLICATIONS

CERTIFIED TO ASSE 1035 & CSA B64.7

Product Description:

LABORATORY FAUCET VACUUM BREAKER:
3/8" NPT MALE INLET & 3/8" NPT FEMALE OUTLET
(NOT RATED FOR CONTINUOUS PRESSURE APPLICATIONS)

Drawn:

JRM

Checked

GEF

Scale:

1' = 1'

Approved

JHB

Date:

02/22/10